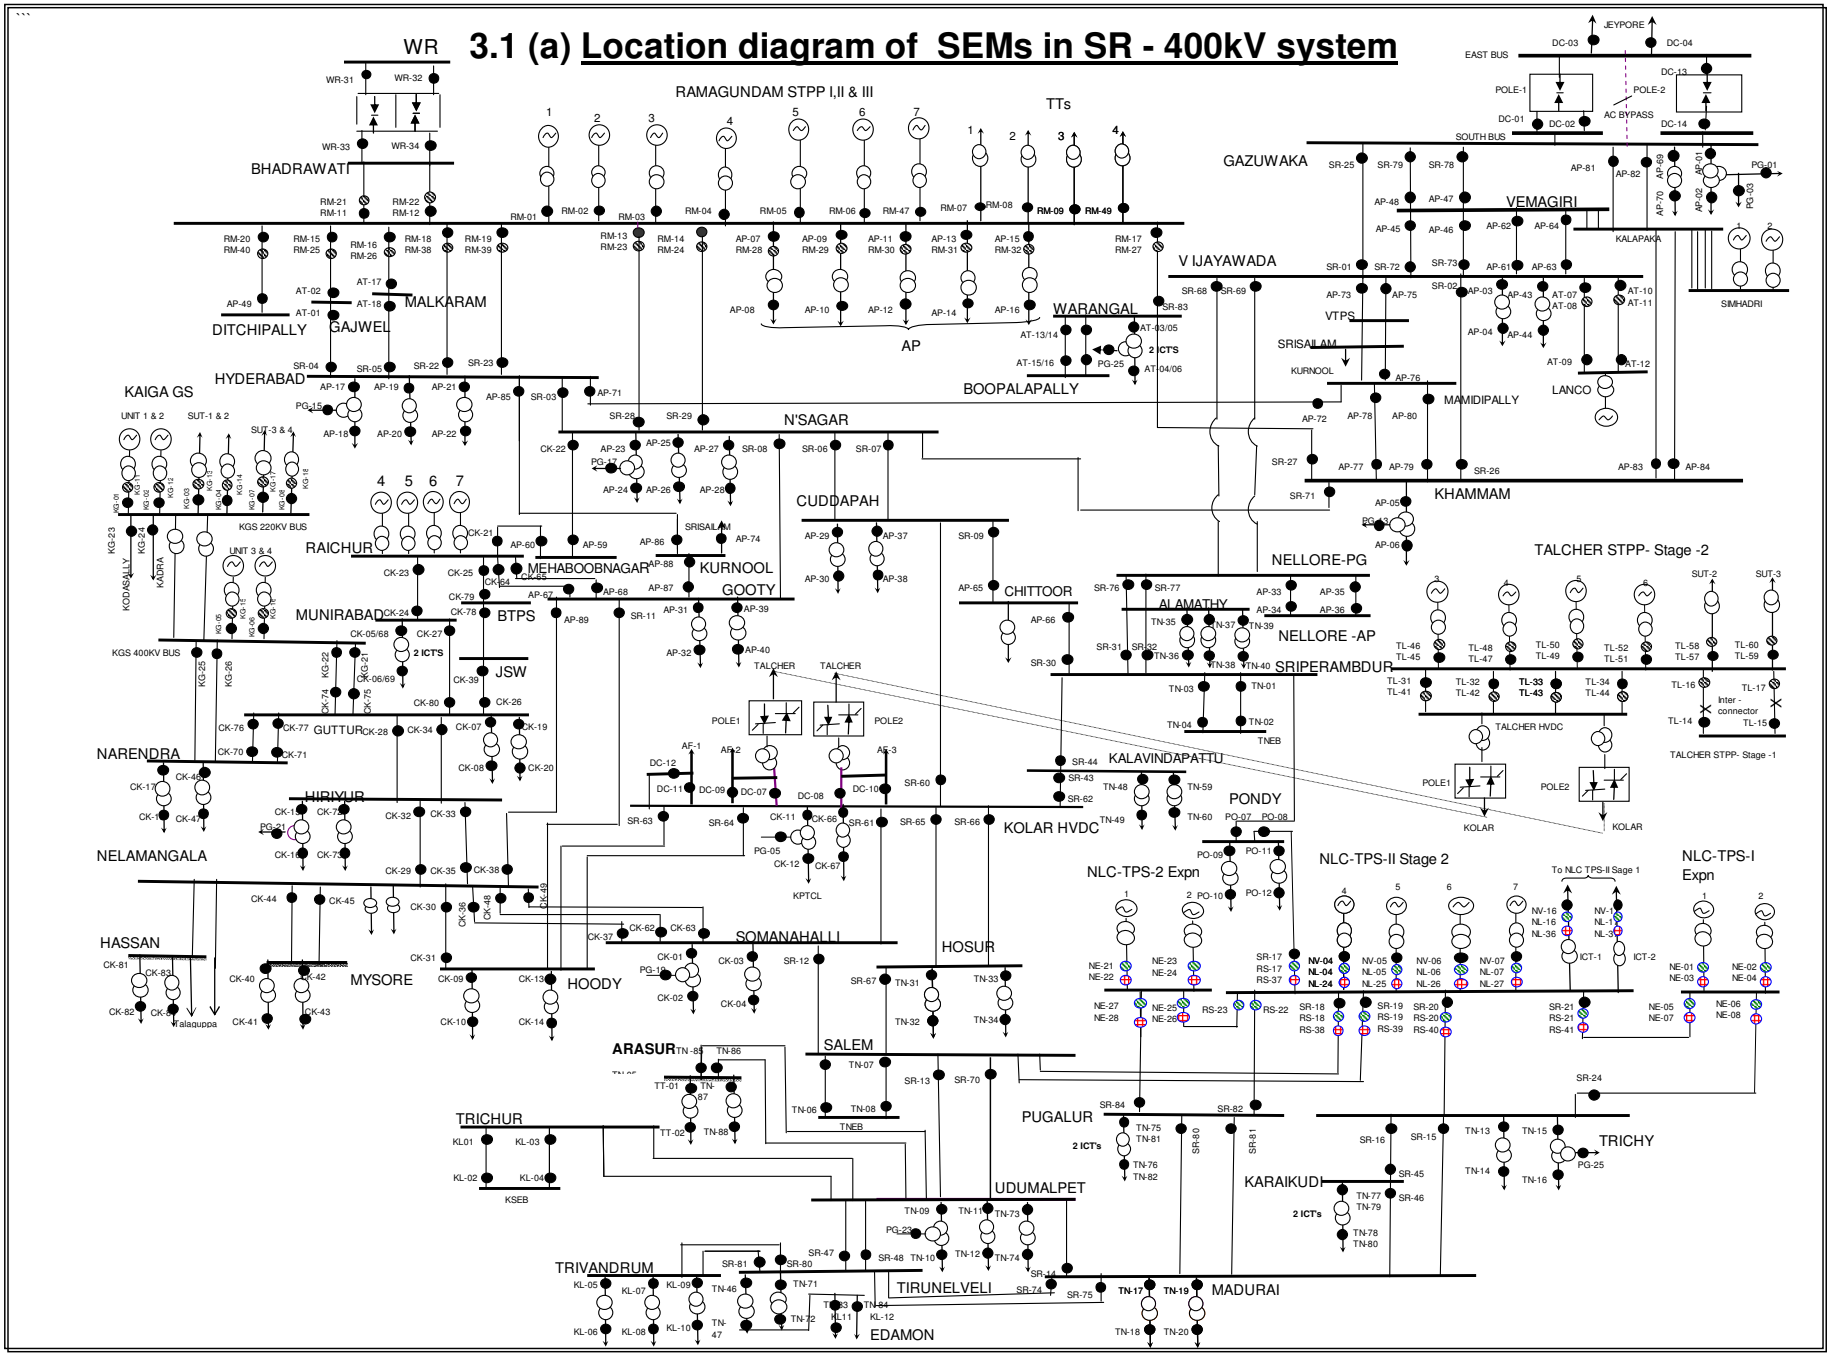3.1 (a) Location diagram of SEMs in SR - 400kV system